


2-15

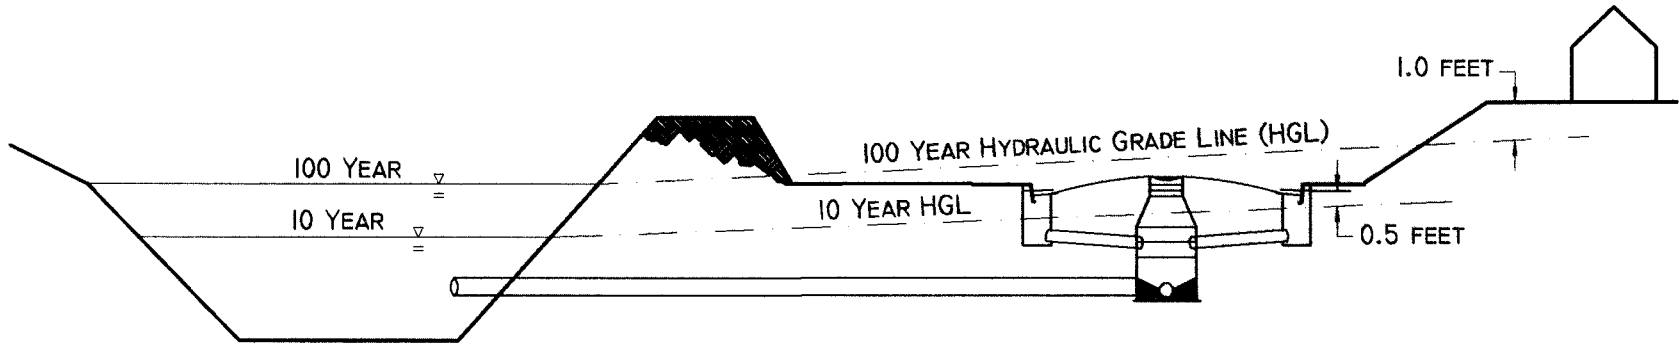

Notes:

- 1. 10 and 100 Year design flows are based on the Sacramento Method unless otherwise directed by the City.
- 2. The 10 Year HGL must be 0.5 feet below the drop inlet.
- 3. The 100 Year HGL must be 1.0 feet below the house pad.

**City of Sacramento
Design Runoff Criteria
New Development**

Date **December 1996**

Figure 2-3